




Salinity Management Pipeline

Information for Potential Dischargers

Salinity Management Pipeline (SMP)


Alignment and Dischargers

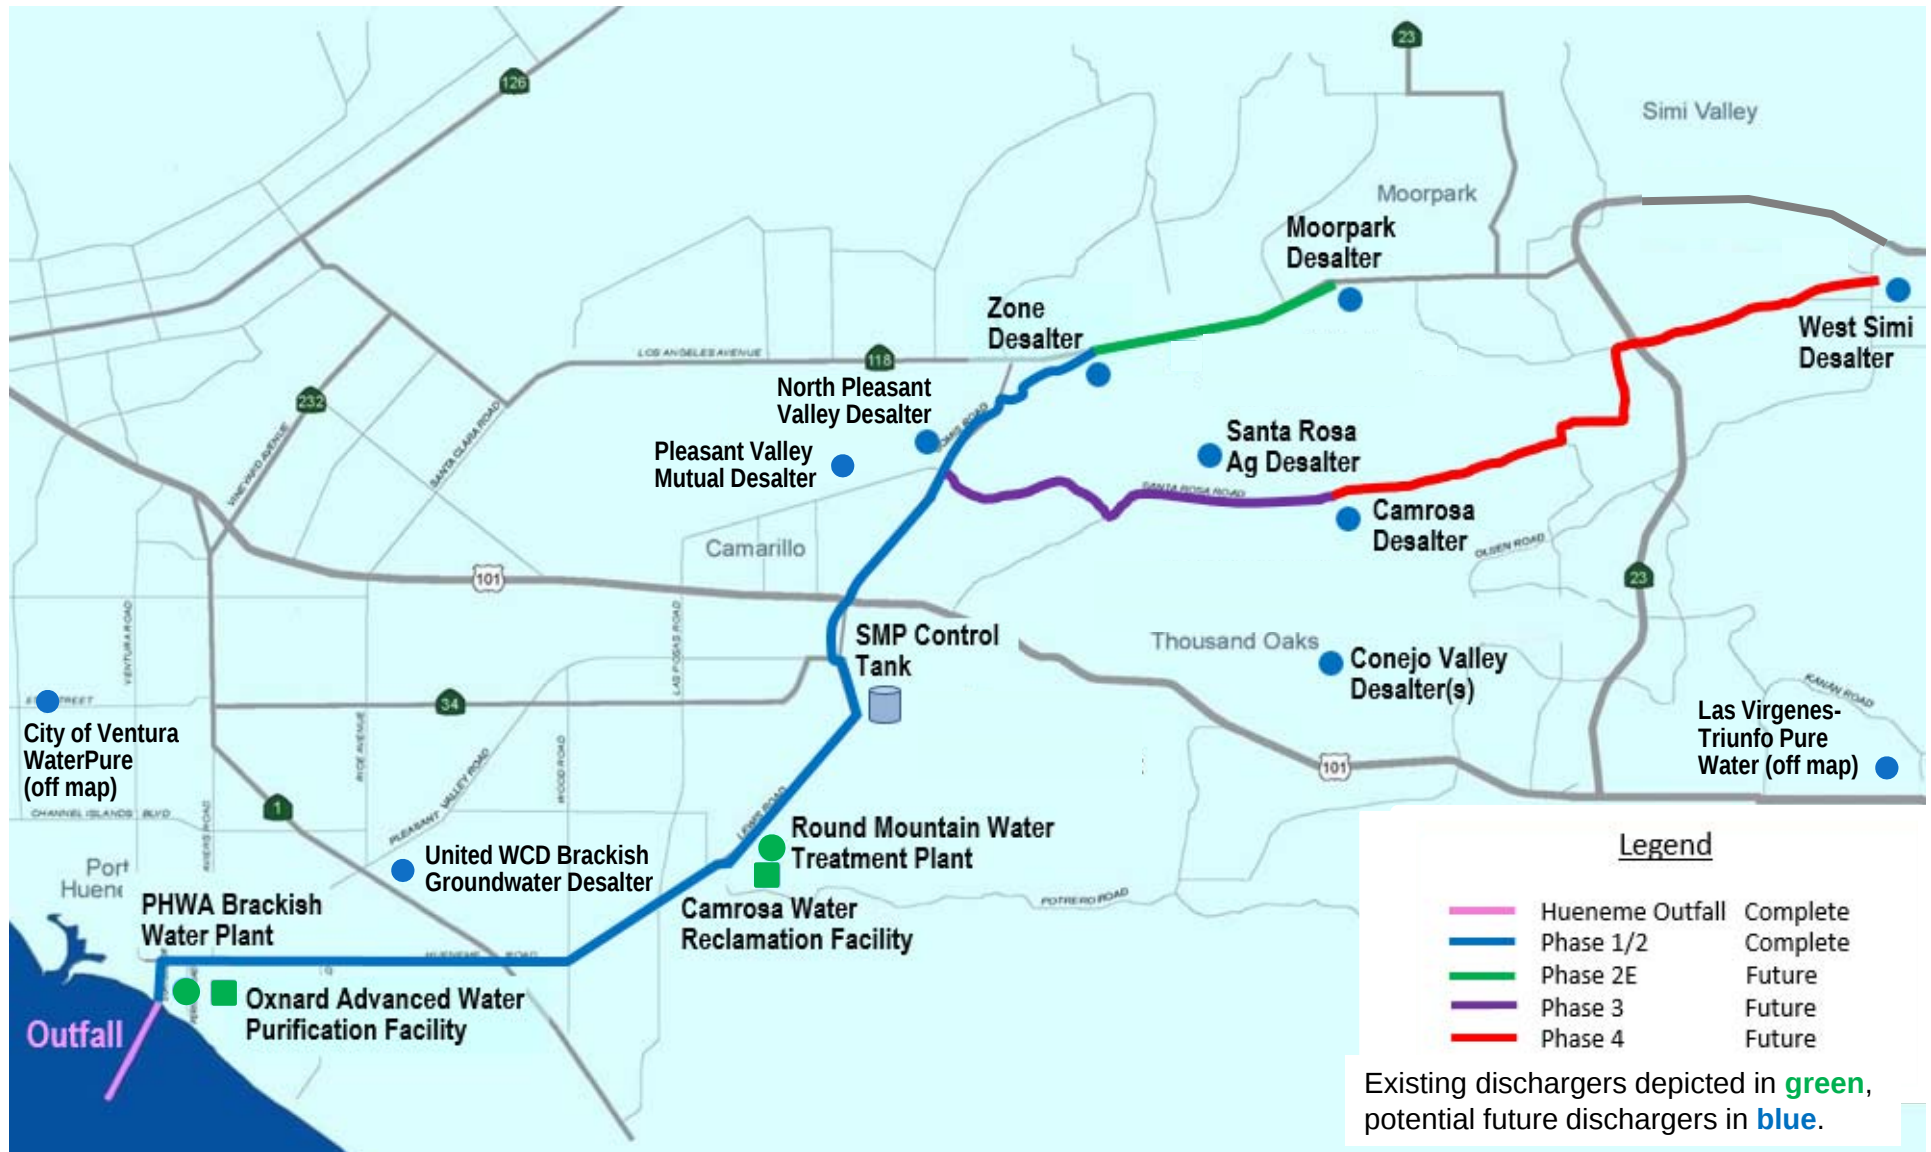

Rate Components for Direct Dischargers to the SMP

- Actual costs to design and build discharge stations (approx. \$200,000 - \$500,000, depending on size and location)
- 0.33% of actual costs to design and build discharge station monthly (replacement charge)
- O&M on each discharge station (estimated \$45,000 per year, includes water quality sampling)
- Dischargers outside the service area pay 50% surcharge on discharge rates because the SMP is subsidized by potable water rates.

Calleguas Service Area

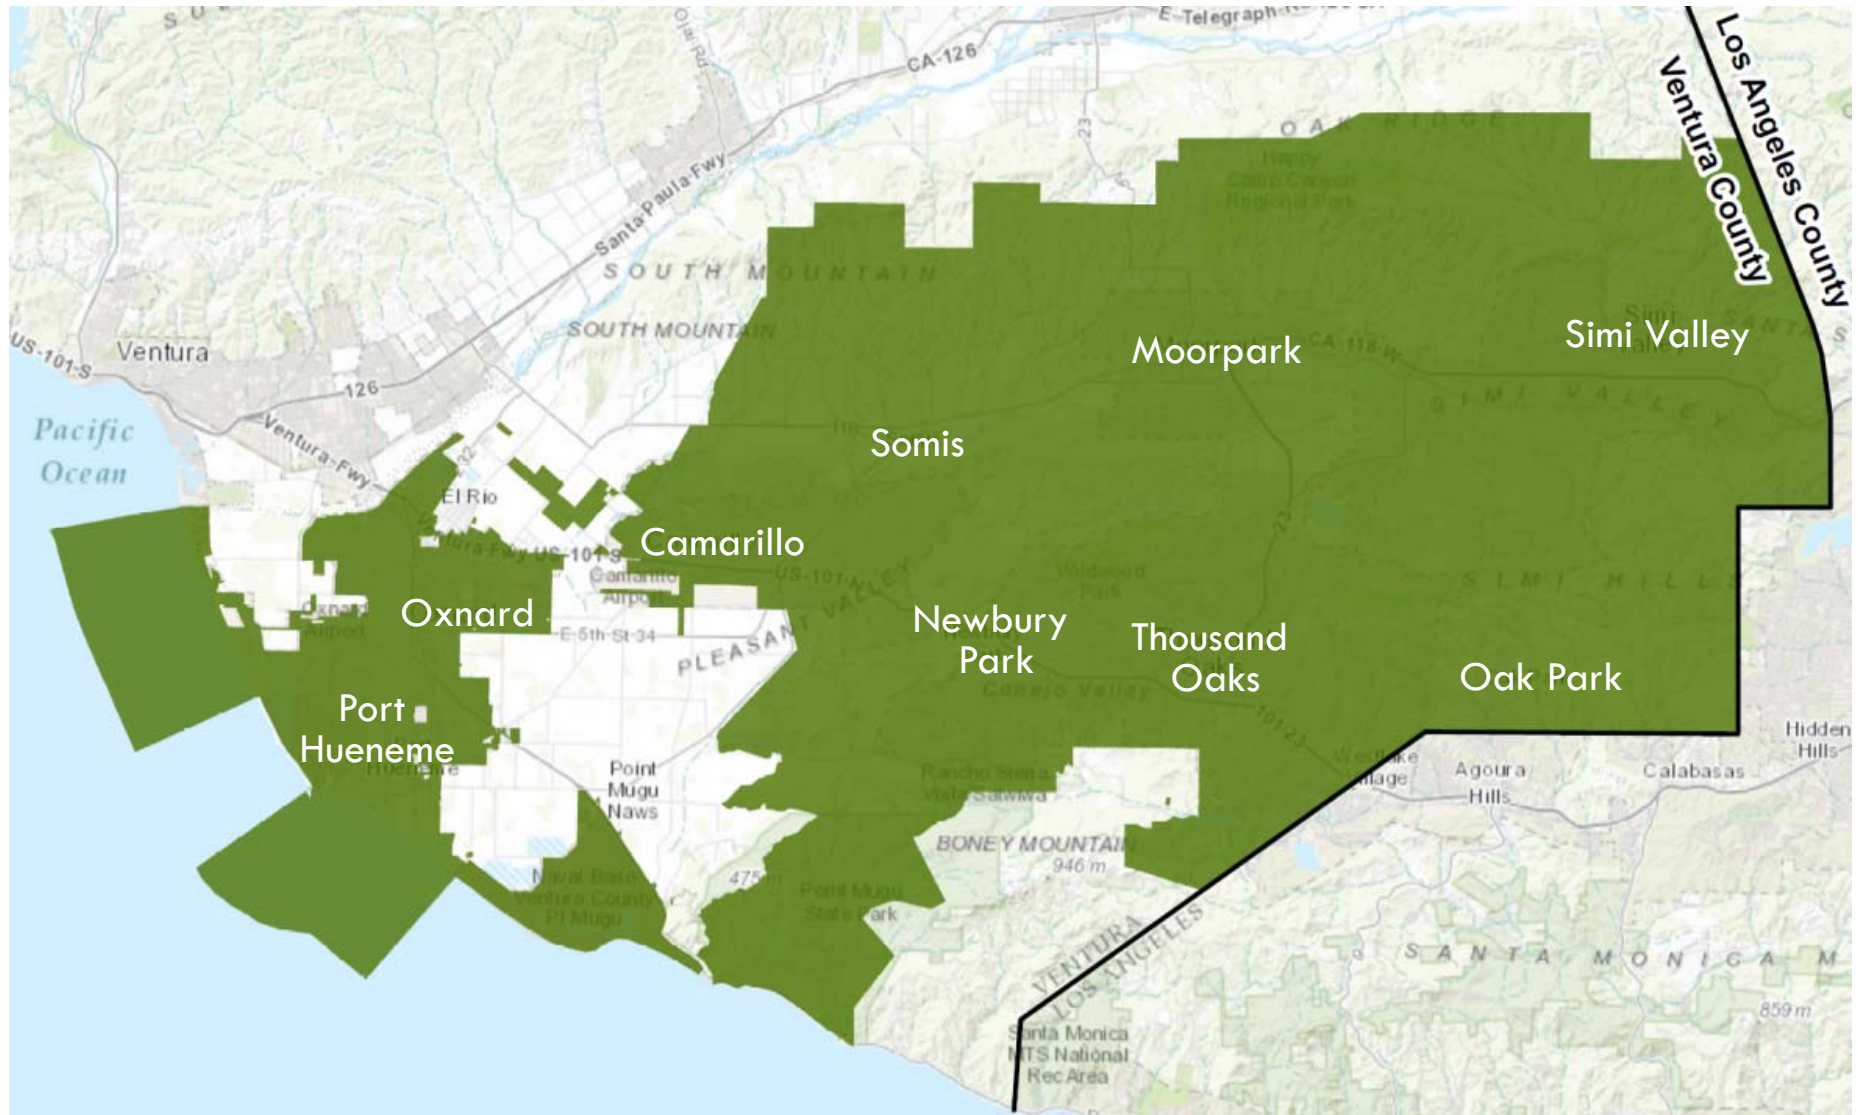


Pipe Hydraulics

- Pipe is under pressure south of Pleasant Valley Road
 - ▣ hydraulic grade line 100' to 130' above sea level
 - ▣ discharges must overcome pressure in the pipe
- Pipe flows by gravity north of Pleasant Valley Road
 - ▣ typically no pressure
 - ▣ some reaches have low pressure due to topographic high points



Salinity Management Pipeline Hydraulic Grade Line

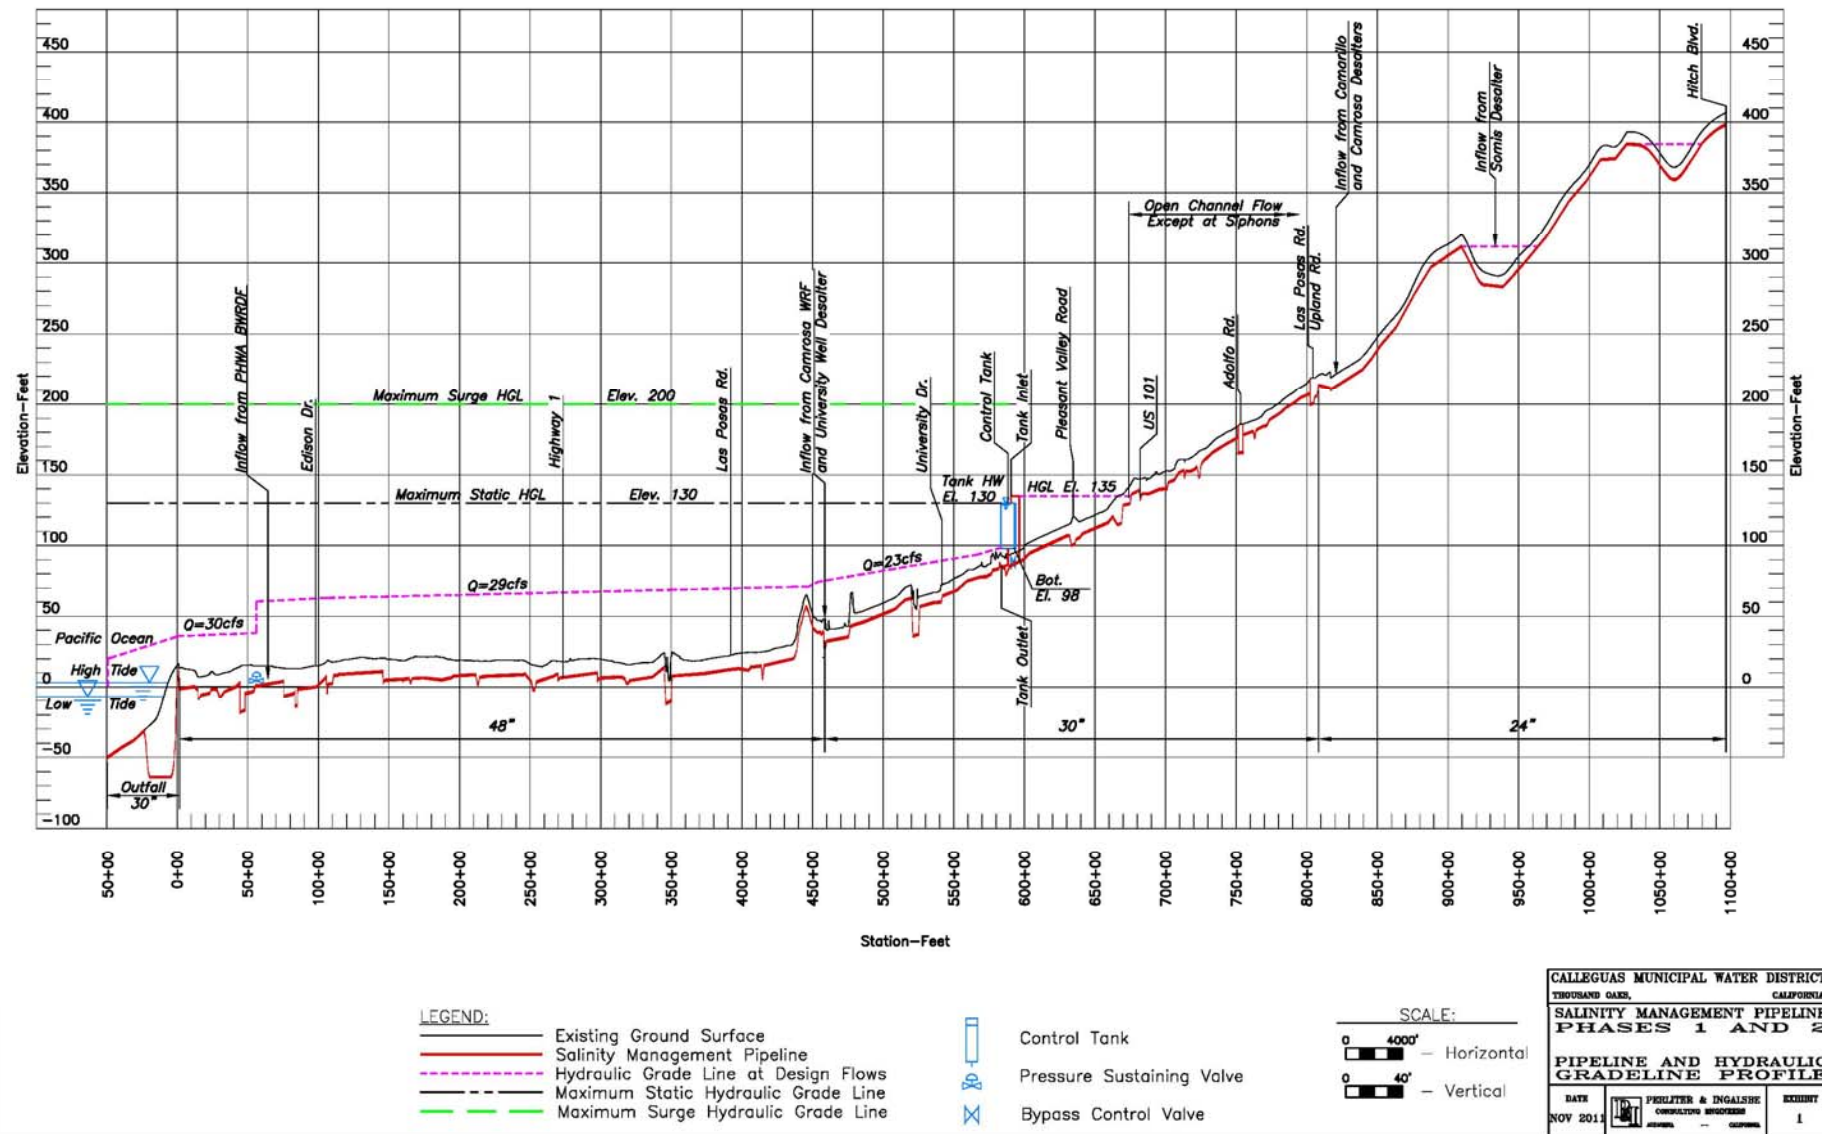



Discharge Station Construction

- ❑ Calleguas to design and build discharge stations
- ❑ Discharger to pay deposit for design and construction prior to commencement of each of those activities



Typical Discharge Station Section

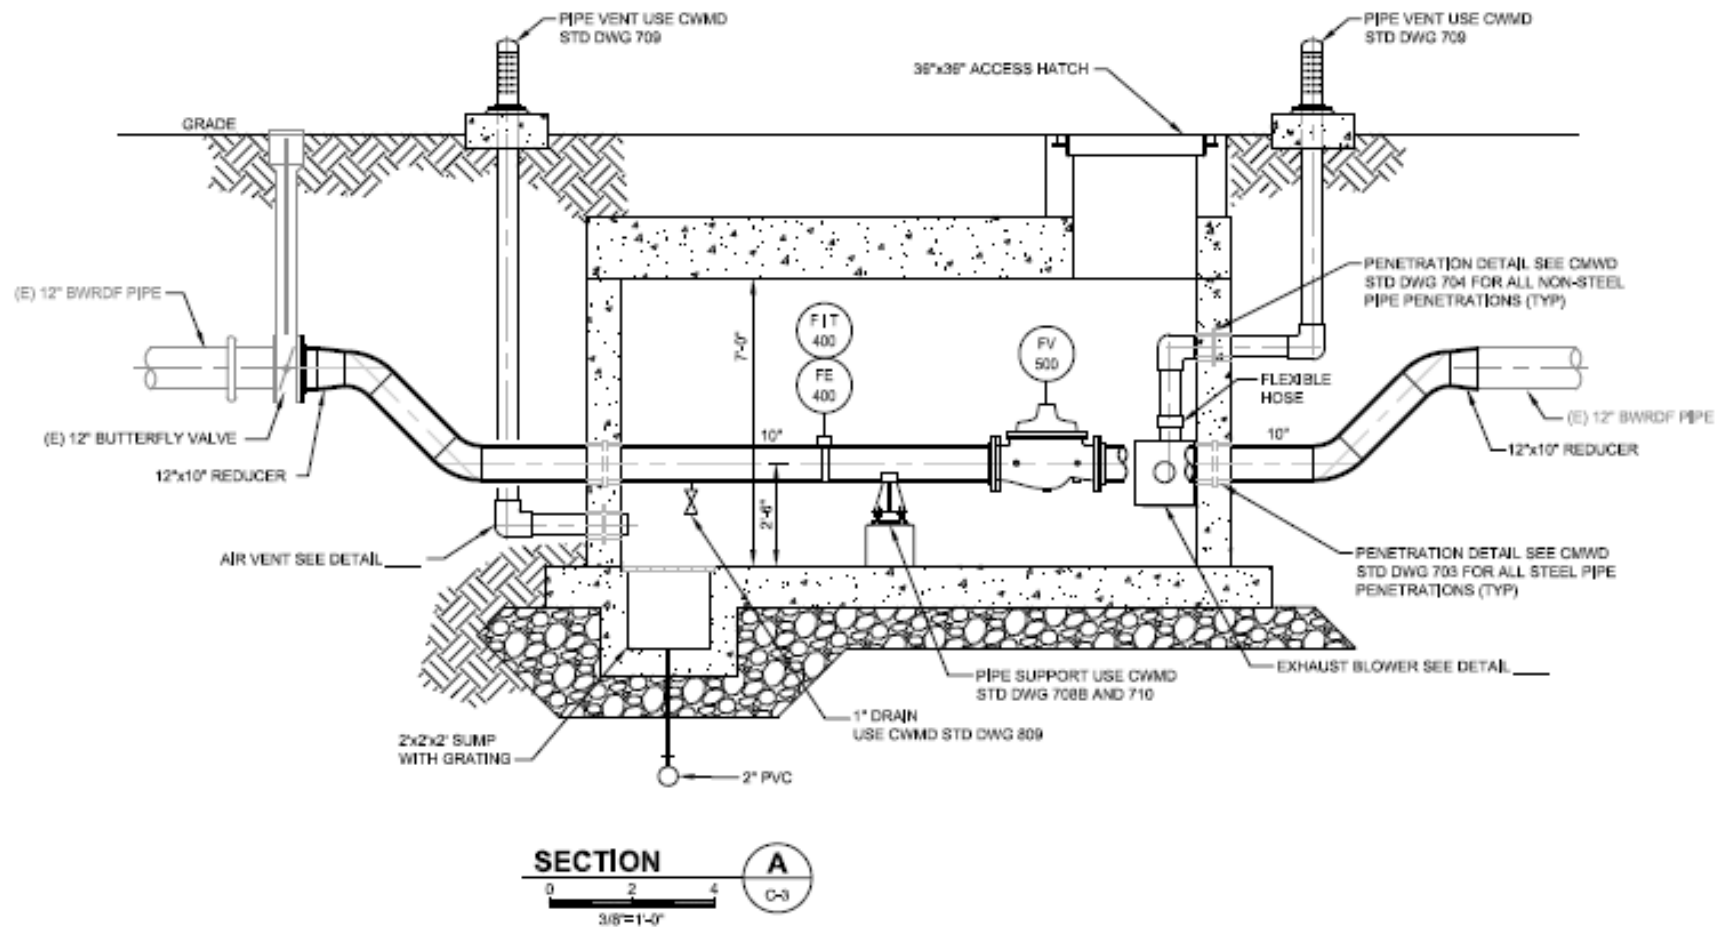

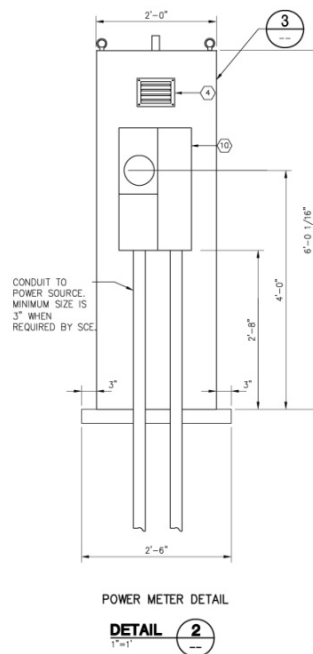

1. CABINET TO BE ANCHORED TO THE CONCRETE PAD PER DRAWING 0-5-S.
2. CONTROL WIRING SHALL BE MARKED WITH ORANGE OR RED HEAT-SHRINK RING MARKERS AT BOTH ENDS.
3. ALL WIRING ENTERING CONTROL CABINET TO BE RUN IN NEC APPROVED, UL RATED CONDUIT PER SPECIFICATION 1610. WIRING FOR POSITION SWITCH, LIGHT AND FAN SHALL BE RUN IN WATERPROOF, FLEXIBLE, NON-FLAMMABLE TUBING.
4. FIELD PENETRATIONS TO THE CONTROL CABINET SHALL BE DE-BURRED, TREATED WITH GOLD GALVANIZED PRIMER AND FINISH WITH FACTORY FINISH PAINT.
5. LIGHT KIT TO BE CENTER MOUNTED ON THE INSIDE FRONT OF CABINET ABOVE THE DOOR. LIGHT KIT SWITCH SHALL DIRECTLY CONTROL THE DOOR.
6. MAINS ENCLOSURE AND PURVEYOR BOX TO BE ATTACHED TO THE CABINET AND THE PENETRATIONS SEALED TO PREVENT ENTRY OF DIRT OR WATER. IN ADDITION, THE LOCATION OF THE MAINS ENCLOSURE AND PURVEYOR BOX ARE TO BE SHOWN ON THE DETAIL SEE ELECTRICAL SITE PLANS FOR DETAILS.
7. PANEL SHALL BE FACTORY PAINTED, FIELD TOUCH UP AS REQUIRED PER SPECIFICATION 1750.
8. CONTRACTOR TO REMOVE LIFTING BOLTS AND PLUG WITH SS BOLTS.
9. ALL ITEMS IN THE BILL OF MATERIALS SHALL BE IDENTIFIED AS MARKED FOR COUL- WITH THE EXCEPTION OF THE AGM MODULES AND THE PLC AND ITS ASSOCIATED PARTS.
10. REFER TO DETAIL 06 DRAWING 0-5-F FOR DETAIL OF DOOR, LIFTING FAN, AND FILTER ASSEMBLY.
11. CABLES, CONNECTORS, TERMINALS AND FUSES TO BE IDENTIFIED AS MARKED FOR COUL.
12. SOME SITES REQUIRE NEMA 4X STAINLESS STEEL CABINETS. REFER TO ELECTRICAL SITE PLANS FOR LOCATIONS AND SPECIFICATION FOR THESE CONSTRUCTION REQUIREMENTS.
13. NOT ALL MAINS ENCLOSURES REQUIRE A SIZE METER, AND SOME SITES DO NOT REQUIRE A MAINS ENCLOSURE. SEE ELECTRICAL SITE PLANS FOR DETAILS.

SINGLE CABINET CONTROL PANEL BILL OF MATERIALS					
ITEM	QTY	MANUFACTURER	PART NUMBER	DESCRIPTION	
1		HOFFMAN	A-72H24753P3	FREE STANDING RIMA & ENCLOSURE, NOTE 12	
2	1	HOFFMAN		BACK PANEL 72" H x 36" W	
3				NOT USED	
4	1	HOFFMAN	T8PS WITH AWK6555 AND T105R	EXHAUST DRILL PACKAGE WITH LOUVER PLATE KIT FILTER SEE CONSTRUCTION NOTE 10.	
5	1	HOFFMAN	T8PS WITH AWK6555 AND T105R	COOLING FAN PACKAGE WITH LOUVER PLATE KIT, FILTER, SEE CONSTRUCTION NOTE 10.	
6	1	HOFFMAN	A-1-CLB21	LIGHT FIXTURE	
7	1	HOFFMAN	A-TENMO	TEMPERATURE CONTROL SWITCH	
8				3-POINT LATCH KIT (INCLUDED IN ITEM 1)	
9	1	HONEYWELL	11.S3	NITROGEN SWITCH	
10	1	COOPER	U214MTBR	MANG. ENCLOSURE WITH 100A MAIN BREAK CENTER, SEE NOTES 6 AND 13.	
11	1	SQUARE D	QO1-6L10GDOGS	LOAD CENTER & 6 CIRCUITS	
12	2	SQUARE D	QO115	15A CIRCUIT BREAKER FOR LOAD CENTER (SPARES)	
13	4	SQUARE D	QO120	20A CIRCUIT BREAKER FOR LOAD CENTER	
14	AS REQ'D	AS	F2X2.G	2" WRING DUCT	
15	REQ'D	PANDUIT	CZGL	2" WRING DUCT COVER	
16	1	ACM	PT74A000-13	SIGNAL ISOLATOR (-4-20 mA)	
17	1	LEVITON	STANDARD	ALUMINUM BOX 2" x 4"	
18	1	LEVITON	7899-GY	DUPLEX RECEPTACLE 20A WITH GFO AND ALUMINUM PLATE	
19	1	LEVITON		DUPLEX RECEPTACLE 20A WITH ALUMINUM PLATE	
20	1	SCHNEIDER	BMX-P34-2020	M340 PROGRAMMABLE LOGIC CONTROLLER	
21	1	SCHNEIDER	BMX-CPS-2010	M340 POWER SUPPLY	
22	1	SCHNEIDER	BMX-JSP-D400	M340 CHASSIS - 8 SLOT	
23	1	SCHNEIDER	BMX-OMI-A600	AI/O MODULE - 4 INPUTS, 2 OUTPUTS	
24	1	SCHNEIDER	BMX-DO-16025	DI/O MODULE - 8 INPUTS, 8 OUTPUTS	
25	2	SCHNEIDER	BMX-FIB-2010	1/2" M12 TERMINAL CONNECTOR	
26	1	ACM	PT74A000-13	BATTERY VOLTS MONITOR	
27	1		PER SPEC 17510	INDUSTRIAL BOX PLC	
28	1	SPECTRUM	WEPORT 2005	4-PORT VPN ROUTER	
29	1	AIRLINK	PER SPEC 17510	CELLULAR MODULE	
30	1	AIRLINK	R15RMA	RJ45 CABLE (LENGTH AS REQ'D)	
31	1	AIRLINK	120-110-2107	CELLULAR ANTENNA (PANEL TOP MOUNT)	
32	1	AIRLINK	(NO PART NUMBER)	SMA CONNECTOR	
33	1	BELDEN		CAT-6 CABLE PG TO ROUTER WITH RJ45 CONNECTORS	
34	1	BELDEN		CAT-6 CABLE ROUTER TO MODERN WITH RJ45 CONNECTORS	
35	1	BELDEN		CAT-6 CABLE PLC TO ROUTER WITH RJ45 CONNECTORS	
36	REQ'D	AS	WDWMULLER	DN RAIL	
37	REQ'D	AS	WDWMULLER	TERMINALS FOR DIN RAIL	
38	REQ'D	AS	WDWMULLER	TERMINALS END PLATE	
39	REQ'D	AS	WDWMULLER	FUSED TERMINALS	
40	REQ'D	AS	WDWMULLER	FUSED TERMINALS END PLATE	
41	REQ'D	AS	WDWMULLER	TERMINALS END BRACKET	
42	REQ'D	AS	WDWMULLER	TERMINALS MARKING TAGS	
43	1		PER SPEC 17510	T20VAC/24 VDC BATTERY BACKUP UNIT	
44	1		PER SPEC 17510	24 VOLT POWER SUPPLY	
45	5	DEC	WRP2-UL-DC24V	RELAY CR1, GR2, CR3, CR4, CR5	
46	5	DEC	SRP2-06	RELAY BASE	
47	REQ'D	BELDEN		CONTROL CABLE, 16 AWG, MTW	
48	REQ'D	BELDEN		CONTROL CABLE, 14 AWG, MTW	
49	REQ'D	BELDEN		CABLE, 18 AWG, TWISTED SHIELDED PAIR	
50	REQ'D	BUSSMAN	GMA500MA	FUSE, 500 mA	
51	REQ'D	BUSSMAN	GMA2A	FUSE, 2 A	
52	AS	WDWMULLER		MINIATURE CB, 1 A	
53	AS	WDWMULLER		MINIATURE CB, 3 A	
54	AS	WDWMULLER		MINIATURE CB, 5 A	
55	1	MELAND	WE.750.120	SURGE PROTECTOR	
56	1	PARI	KPP-144G-120	RELAY	
57	1	PARI	Z7E8R2	UPPLY BASE - RL1	
58	2		PER SPEC 17510	RL1 BATTERY	
59	1	COOPER	A419NKC	4" x 4" x 4" WIDEWAY WITH END CAPS	
60	1	HOFFMAN	A-6PR4	NEMA 4X "D" 4" X 4" TERMINAL BLOCKS WITH 24 #16'S SEE DETAIL, 4 THIS SHEET.	
61	AS REQ'D		PADLOCKABLE	IT CONDUT AND FITTINGS FROM METER ENCLOSURE	
62	1		PER SPEC 17510	INVERTER	

Discharge Limits

Important Considerations

- Each individual discharge must always be at or below the limitations in the NPDES permit.
- When testing a potential discharge for compliance with the discharge limits, please note the very low concentrations.
 - ▣ Special lab methods are needed.
 - ▣ Seek advice from a water quality expert.

Discharge Limits

Important Considerations

- Please note that the frequency of monitoring often **does not** correlate with the time intervals of the discharge limits. For example, many constituents have instantaneous and daily maxima, but the most frequent monitoring is performed monthly.
- The discharge must meet the standard for the time interval actually monitored. In many cases, that means the discharge must meet the more stringent monthly or 6-month discharge limit rather than the less stringent weekly, daily, or instantaneous limit.

Discharge Limits

Important Considerations

- The concentration-based limits contained in the permit are on the following pages. (There are also mass-based limitations.)
- Constituents with asterisks are defined in the Monitoring Requirements section.

Discharge Limits

Constituent	Units	Instantaneous Maximum	Median of 1 Tidal Cycle
Temperature	°F	Receiving Water + 20°	Receiving Water + 4°

Constituent	Units	Minimum	Maximum
pH	pH units	6.0	9.0

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
BOD (5-day @ 20° C)	mg/L	30	45	--	--	--
Oil and Grease	mg/L	25	40	--	75	--
Settleable Solids	mL/L	1.0	1.5	--	3.0	--
Total Suspended Solids	mg/L	60	--	--	--	--
Turbidity	NTU	75	100	--	225	--
Total Residual Chlorine	µg/L	--	--	580	4,400	150
Ammonia (as N)	µg/L	--	--	180,000	440,000	44,000
Chronic Toxicity	P/F % Effect	Pass	--	Pass or % Effect < 50	--	--

Discharge Limits

Constituent	Units	Geometric Mean	Single Sample Maximum
Total coliform	MPN / 100 mL	1,000	10,000; 1,000 if fecal/total ratio exceeds 0.1
Fecal coliform	MPN / 100 mL	200	400
Enterococcus	MPN / 100 mL	35	104

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Antimony (Total Recoverable)	µg/L	88,000	--	--	--	--
Arsenic (Total Recoverable)	µg/L	--	--	2,100	5,600	370
Beryllium (Total Recoverable)	µg/L	2.4	--	--	--	--
Cadmium (Total Recoverable)	µg/L	--	--	290	730	73
Chromium III (Total Recoverable)	µg/L	1.4E+07	--	--	--	--
Chromium VI (Total Recoverable)	µg/L	--	--	580	1,500	150
Copper (Total Recoverable)	µg/L	--	--	730	2,000	75
Lead (Total Recoverable)	µg/L	--	--	580	1,500	150
Mercury (Total Recoverable)	µg/L	--	--	12	29	2.9
Nickel (Total Recoverable)	µg/L	--	--	1,500	3,700	370
Selenium (Total Recoverable)	µg/L	--	--	4,400	11,000	1,100

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Silver (Total Recoverable)	µg/L	--	--	190	500	40
Thallium (Total Recoverable)	µg/L	150	--	--	--	--
Zinc (Total Recoverable)	µg/L	--	--	5,300	14,000	880
Cyanide	µg/L	--	--	290	730	73
Non-chlorinated Phenolic Compounds*	µg/L	--	--	8,800	22,000	2,200
Chlorinated Phenolics*	µg/L	--	--	290	730	73
TCDD Equivalents*	µg/L	2.8E-07	--	--	--	--
Acrolein	µg/L	16,000	--	--	--	--
Acrylonitrile	µg/L	7.3	--	--	--	--
Benzene	µg/L	430	--	--	--	--
Carbon Tetrachloride	µg/L	66	--	--	--	--

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Chlorobenzene	µg/L	42,000	--	--	--	--
Chlorodibromomethane	µg/L	630	--	--	--	--
Chloroform	µg/L	9,500	--	--	--	--
Dichlorobromomethane	µg/L	450	--	--	--	--
1,2-Dichloroethane	µg/L	2,000	--	--	--	--
1,1-Dichloroethylene	µg/L	66	--	--	--	--
1,3-Dichloropropylene	µg/L	650	--	--	--	--
Ethylbenzene	µg/L	3.0E+5	--	--	--	--
Halomethanes*	µg/L	9,500	--	--	--	--
Dichloromethane	µg/L	33,000	--	--	--	--
1,1,2,2-Tetrachloroethane	µg/L	170	--	--	--	--

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Tetrachloroethylene	µg/L	150	--	--	--	--
Toluene	µg/L	6.2E+06	--	--	--	--
1,1,1-Trichloroethane	µg/L	3.9E+07	--	--	--	--
1,1,2-Trichloroethane	µg/L	690	--	--	--	--
Trichloroethylene	µg/L	2,000	--	--	--	--
Vinyl Chloride	µg/L	2,600	--	--	--	--
4,6-dinitro-2-methylphenol	µg/L	16,000	--	--	--	--
2,4-Dinitrophenol	µg/L	290	--	--	--	--
2,4,6-Trichlorophenol	µg/L	21	--	--	--	--
Benzidine	µg/L	0.0050	--	--	--	--
PAH*	µg/L	0.64	--	--	--	--
Bis(2-Chloroethoxy)Methane	µg/L	320	--	--	--	--

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Bis(2-Chloroethyl)Ether	µg/L	3.3	--	--	--	--
Bis(2-chloroisopropyl)Ether	µg/L	88,000	--	--	--	--
Bis(2-Ethylhexyl)Phthalate	µg/L	260	--	--	--	--
Dichlorobenzenes	µg/L	3.7E+05	--	--	--	--
1,4-Dichlorobenzene	µg/L	1,300	--	--	--	--
3,3'-Dichlorobenzidine	µg/L	0.59	--	--	--	--
Diethyl Phthalate	µg/L	2.4E+06	--	--	--	--
Dimethyl Phthalate	µg/L	6.0E+07	--	--	--	--
Di-n-Butyl Phthalate	µg/L	2.6E+05	--	--	--	--
2,4-Dinitrotoluene	µg/L	190	--	--	--	--
1,2-Diphenylhydrazine	µg/L	12	--	--	--	--
Fluoranthene	µg/L	1,100	--	--	--	--

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Hexachlorobenzene	µg/L	0.015	--	--	--	--
Hexachlorobutadiene	µg/L	1,000	--	--	--	--
Hexachlorocyclopentadiene	µg/L	4,200	--	--	--	--
Hexachloroethane	µg/L	180	--	--	--	--
Isophorone	µg/L	53,000	--	--	--	--
Nitrobenzene	µg/L	360	--	--	--	--
N-Nitrosodimethylamine	µg/L	530	--	--	--	--
N-Nitrosodi-N-Propylamine	µg/L	28	--	--	--	--
N-Nitrosodiphenylamine	µg/L	180	--	--	--	--
Aldrin	µg/L	0.0016	--	--	--	--
HCH*	µg/L	--	--	0.58	0.88	0.29
Chlordane	µg/L	0.0017	--	--	--	--

Discharge Limits

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
DDT*	µg/L	0.012	--	--	--	--
Dieldrin	µg/L	0.0029	--	--	--	--
Endosulfan	µg/L	--	--	1.3	2.0	0.66
Endrin	µg/L	--	--	0.29	0.44	0.15
Heptachlor	µg/L	0.0037	--	--	--	--
Heptachlor Epoxide	µg/L	0.0015	--	--	--	--
PCBs*	µg/L	0.0014	--	--	--	--
Toxaphene	µg/L	0.015	--	--	--	--
Tributyltin	µg/L	0.10	--	--	--	--

Triggers

Constituent	Units	Average Monthly	Average Weekly	Daily Maximum	Instantaneous Maximum	6-Month Median
Gross alpha	pCi/L	--	--	15	--	--
Gross beta	pCi/L	--	--	50	--	--
Combined Radium-226 & Radium-228	pCi/L	--	--	5.0	--	--
Tritium	pCi/L	--	--	20,000	--	--
Strontium-90	pCi/L	--	--	8.0	--	--
Uranium	pCi/L	--	--	20	--	--

Note that these are not limits. They are triggers for additional monitoring.

Monitoring Requirements

Important Considerations

- Note that there are constituents that must be monitored that do not have a discharge limit.
- The method listed is the most common method used to meet the required minimum levels. Other methods that are approved under 40 CFR 136.3, 136.4, and 136.5 may be used.
- Note that high concentration brines can have interference issues and the analytical laboratory must ensure the method is appropriate for the discharge characteristics.

Monitoring Requirements

Important Considerations

- All samples are grab samples.
- The Minimum Level represents the most stringent minimum level for the constituent. The analytical method chosen should be able to achieve this minimum level. If the constituent does not have a minimum level listed, the selected analysis method minimum level should be lower than the discharge limit.

Monitoring Requirements

Monthly

Constituent	Units	Method	Min. Level
Temperature	°F	Field probe	N/A
pH	pH units	Field probe	N/A
Total coliform	MPN/100 mL	SM 9221B	N/A
Fecal coliform	MPN/100 mL	SM 9221E	N/A
Enterococcus	MPN/100 mL	SM 9230B	N/A
Dissolved Oxygen	mg/L	Field probe	N/A
Ammonia (as N)	µg/L	SM 4500-NH3 F	N/A
Total Residual Chlorine	µg/L	Field probe	N/A

Monitoring Requirements

Monthly

Constituent	Units	Method	Min. Level
Chronic Toxicity	P/F or % Effect	TST	N/A
Antimony (Total Recoverable)	µg/L	EPA 1640 or 200.8	0.5
Arsenic (Total Recoverable)	µg/L	EPA 1640 or 200.8	1
Beryllium (Total Recoverable)	µg/L	EPA 1640 or 200.8	0.5
Cadmium (Total Recoverable)	µg/L	EPA 1640 or 200.8	0.2
Chromium III (Total Recoverable)	µg/L	Calculated	N/A
Chromium VI (Total Recoverable)	µg/L	EPA 218.6	5
Copper (Total Recoverable)	µg/L	EPA 1640 or 200.8	0.5
Lead (Total Recoverable)	µg/L	EPA 1640 or 200.8	0.5
Mercury (Total Recoverable)	µg/L	EPA 245.1	0.2
Nickel (Total Recoverable)	µg/L	EPA 1640 or 200.8	1
Selenium (Total Recoverable)	µg/L	EPA 1640 or 200.8	1

Monitoring Requirements

Monthly

Constituent	Units	EPA Method	Min. Level
Silver (Total Recoverable)	µg/L	EPA 1640 or 200.8	0.2
Thallium (Total Recoverable)	µg/L	EPA 1640 or 200.8	1
Zinc (Total Recoverable)	µg/L	EPA 1640 or 200.8	1
Cyanide	µg/L	SM 4500 CN-E	5
Non-Chlorinated Phenolic Compounds ¹	µg/L	EPA 625	varies
Chlorinated Phenolics ²	µg/L	EPA 625	varies
TCDD Equivalents ³	µg/L	EPA 1613B	varies

¹ Non-Chlorinated phenolic compounds represent the sum of 2-nitrophenol; phenol; 2,4-dimethylphenol; 2,4-dinitrophenol; 2-methyl-4,6-dinitrophenol; and 4-nitrophenol.

² Chlorinated phenolic compounds represent the sum of 2-chlorophenol; 2,4-dichlorophenol; 2,4,6-trichlorophenol; 4-chloro-3-methylphenol; and pentachlorophenol.

³ TCDD Equivalents are the sum of 2,3,7,8-tetra CDD; 2,3,7,8-penta CDD; 2,3,7,8-hexa CDDs; 2,3,7,8-hepta CDD; octa CDD, 2,3,7,8 tetra CDF; 1,2,3,7,8 penta CDF; 2,3,4,7,8 penta CDF; 2,3,7,8 hexa CDFs; 2,3,7,8 hepta CDFs; and octa CDF weighted by their toxicity equivalence factors in Attachment A to the permit.

Monitoring Requirements

Monthly

Constituent	Units	Method	Min. Level
Acrolein	µg/L	EPA 624	2
Acrylonitrile	µg/L	EPA 624	2
Benzene	µg/L	EPA 624	0.5
Carbon Tetrachloride	µg/L	EPA 624	0.5
Chlorobenzene	µg/L	EPA 624	0.5
Chlorodibromomethane	µg/L	EPA 624	0.5
Chloroform	µg/L	EPA 624	0.5
Dichlorobromomethane	µg/L		
1,2-Dichloroethane	µg/L	EPA 624	0.5
1,1-Dichloroethylene	µg/L	EPA 624	0.5
1,3-Dichloropropylene	µg/L		
Ethylbenzene	µg/L	EPA 624	0.5

Monitoring Requirements

Monthly

Constituent	Units	Method	Min. Level
Halomethanes ¹	µg/L	EPA 624	0.5
Dichloromethane	µg/L	EPA 624	0.5
1,1,2,2-Tetrachloroethane	µg/L	EPA 624	0.5
Tetrachloroethylene	µg/L	EPA 624	0.5
Toluene	µg/L	EPA 624	0.5
1,1,1-Trichloroethane	µg/L	EPA 625	0.5
1,1,2-Trichloroethane	µg/L	EPA 624	0.5
Trichloroethylene	µg/L	EPA 624	0.5
Vinyl Chloride	µg/L	EPA 624	0.5
4,6-Dinitro-2-Methylphenol	µg/L	EPA 625	5
2,4-Dinitrophenol	µg/L	EPA 625	5

¹ **Halomethanes** is sum of bromoform, bromomethane (methyl bromide), and chloromethane (methyl chloride).

Monitoring Requirements

Monthly

Constituent	Units	Method	Min. Level
2,4,6-Trichlorophenol	µg/L	EPA 625	10
Benzidine	µg/L	EPA 625	5
PAH ¹	µg/L	EPA 625	2
Bis(2-Chloroethoxy)Methane	µg/L	EPA 625	5
Bis(2-Chloroethyl)Ether	µg/L	EPA 625	1
Bis(2-Chloroisopropyl)Ether	µg/L	EPA 625	2
Bis(2-Ethylhexyl)Phthalate	µg/L	EPA 625	5
Dichlorobenzenes	µg/L	EPA 624	1

¹ PAH is sum of acenaphthylene, anthracene, 1,2-benzanthracene, 3,4-benzofluoranthene, benzo(k)fluoranthene, 1,12-benzonperylene, benzo(a)pyrene, chrysene, dibenzo(ah)anthracene, fluorene, indeno(1,2,3-cd)pyrene, phenanthrene and pyrene.

Monitoring Requirements

Monthly

Constituent	Units	EPA Method	Min. Level
1,4-Dichlorobenzene	µg/L	EPA 625	1
3,3'-Dichlorobenzidine	µg/L	EPA 625	5
Diethyl Phthalate	µg/L	EPA 625	2
Dimethyl Phthalate	µg/L	EPA 625	2
Di-n-butyl Phthalate	µg/L	EPA 625	10
2,4-Dinitrotoluene	µg/L	EPA 625	5
1,2-Diphenylhydrazine	µg/L	EPA 625	1
Fluoranthene	µg/L	EPA 625	0.05
Hexachlorobenzene	µg/L	EPA 625	1
Hexachlorobutadiene	µg/L	EPA 625	1
Hexachlorocyclopentadiene	µg/L	EPA 625	5
Hexachloroethane	µg/L	EPA 625	1

Monitoring Requirements

Monthly

Constituent	Units	Method	Min. Level
Isophorone	µg/L	EPA 624	1
Nitrobenzene	µg/L	EPA 625	1
N-Nitrosodimethylamine	µg/L	EPA 625	5
N-Nitrosodi-N-Propylamine	µg/L	EPA 625	5
N-Nitrosodiphenylamine	µg/L	EPA 625	1
Aldrin	µg/L	EPA 625 / 8270	0.005
HCH ¹	µg/L	EPA 608	0.005
Chlordane	µg/L	EPA 625 / 8270	0.1
DDT ²	µg/L	EPA 625 / 8270	0.01

¹ HCH is sum of alpha, beta, gamma (lindane) and delta-HCH.

² DDT is the sum of 4,4'DDT; 2,4'DDT; 4,4'DDE; 2,4'DDE; 4,4'DDD; and 2,4',DDD.

Monitoring Requirements

Monthly

Constituent	Units	EPA Method	Min. Level
Dieldrin	µg/L	EPA 625 / 8270	0.01
Endosulfan a	µg/L	EPA 625 / 8270	0.01
Endosulfan b	µg/L	EPA 625 / 8270	0.02
Endrin	µg/L	EPA 625 / 8270	0.01
Heptachlor	µg/L	EPA 625 / 8270	0.01
Heptachlor Epoxide	µg/L	EPA 625 / 8270	0.01
PCBs ¹	µg/L	EPA 608	0.5
Toxaphene	µg/L	EPA 608	0.5
Tributyltin	µg/L	EPA 282.3	N/A

¹ PCBs is sum of Aroclor-1016, Aroclor-1221, Aroclor-1232, Aroclor-1242, aroclor-1248, Aroclor-1254, and Aroclor-1260.

Monitoring Requirements

Quarterly

Constituent	Units	Method	Min. Level
BOD (5-day @ 20° C)	mg/L	SM 5210B	N/A
Oil and Grease	mg/L	1664	N/A
Settleable Solids	mL/L	SM 2540F	N/A
Total Suspended Solids	mg/L	SM 2540D	N/A
Turbidity	NTU	180.1	N/A

Monitoring Requirements Semi-Annually

Constituent	Units	Method	Min. Level
Gross alpha	pCi/L	EPA 900.0	N/A
Gross beta	pCi/L	EPA 900.0	N/A
Combined Radium-226 & Radium-228	pCi/L	EPA 903.0/903.1 EPA 904.0	N/A
Tritium	pCi/L	EPA 906.0	N/A
Strontium-90	pCi/L	EPA 905.0	N/A
Uranium	pCi/L	EPA 908.0	N/A

Note: If the gross alpha and/or gross beta exceed the triggers, combined radium-226 and radium-228 will be analyzed. If the combined radium results are exceed the triggers, then tritium, strontium-90 and uranium analyses will be conducted.

For Additional Information

- Visit <http://smp.calleguas.com> for:
 - ▣ Ordinance 19 - An Ordinance of Calleguas Municipal Water District Covering the Rules and Regulations for Use of the Salinity Management Pipeline
 - ▣ NPDES Permit for the SMP Outfall
 - ▣ Example Discharge Agreement
 - ▣ Discharge Service Information Request Form
 - ▣ SMP Rates

Questions?

- Fernando Baez, P.E.
Manager of Engineering
fbaez@calleguas.com
(805) 579-7156